



ETA-Danmark A/S
Göteborg Plads 1
DK-2150 Nordhavn
Tel. +45 72 24 59 00
Internet www.etadanmark.dk

Authorised and notified according
to Article 29 of the Regulation (EU)
No 305/2011 of the European
Parliament and of the Council of 9
March 2011

MEMBER OF EOTA



European Technical Assessment ETA-25/0502 of 2025/05/30

I General Part

Technical Assessment Body issuing the ETA and designated according to Article 66 of the Regulation (EU) No 305/2011: ETA-Danmark A/S

**Trade name of the
construction product:**

FireFree Brandfugesystem

**Product family to which the
above construction product
belongs:**

Linear Joint & Gap Sealing for building components

Manufacturer:

Scandi Supply A/S
Energivej 2,
DK-5492 Vissenbjerg
Internet www.scandisupply.dk

Manufacturing plant:

Plant LEI

**This European Technical
Assessment contains:**

15 pages including 3 annexes which form an integral
part of the document

**This European Technical
Assessment is issued in
accordance with Regulation
(EU) No 305/2011, based on:**

EAD 350141-00-1106, Linear joint and gap seals

This version replaces:

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted the confidential Annex(es) referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction must be identified as such.

II SPECIFIC PART OF THE EUROPEAN TECHNICAL ASSESSMENT

1 Technical description of the product

The joint sealing FireFree Brandfugesystem essentially consists of lamella mat Klimarock and an ablative coating.

It is delivered as Joint sealing between neighboring building components, solid walls and floors, fire resistance class according to table 3 of this ETA.

Detailed specifications for identification and performance criteria for fire safety regarding the construction products are given in the annexes of this ETA.

2 Specification of the intended use(s) in accordance with the applicable European Assessment Document (hereinafter EAD)

The thickness of the joint sealing for wall and floor seals are ≤ 100 mm.

The width of the joint sealing for wall and floor seals are ≤ 200 mm.

The intended use of the product is to form linear joints or gap seals with movement capability less than 7.5% (non-movement joints).

The position of the joint sealing in the joint is in the lower part, the upper part or in the middle part.

Orientation of the application of FireFree Brandfugesystem

- Installation of joint sealing in horizontal components
- Installation of vertical joint sealing in vertical components
- Installation of horizontal joint sealing in vertical components
- Installation of horizontal wall joints connection to floors
- Installation of horizontal floor joint connection to walls

Classification of the joint sealing FireFree Brandfugesystem:

Double layer 50 joint seal system: EI 120

Single layer 50 joint seal system: EI 60/E 120

More information in table 3: "Performance of the product and references to the methods used for its assessment" to be used to form linear joint or gap seals with movement capability less than 7.5% (non-movement joints).

The joint sealing system are to be installed according to the manufacturers installation manual.

The provisions made in this European Technical Assessment are based on an assumed intended working life of the FireFree Brandfugesystem of 10 years, provided the manufacturers conditions for the packaging, transport, storage, installation, use, maintenance and repair are met.

The indications given on the working life cannot be interpreted as a guarantee given by the producer or Assessment Body but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

Characteristic	Assessment of characteristic
3.1 Safety in case of fire (BWR2)	
Reaction to fire	The product is classified as Euroclass E in accordance with EN13501-1, and the EC Delegated regulation 2016/364/EU.
Resistance to fire	<p>Classification according to EN 13501-2:</p> <p>Fire resistance class of vertical linear joint seals system with mineral fiber board in wall: EI 120</p> <p>Fire resistance class of horizontal linear joint seals system with mineral fiber board in wall: EI 120</p> <p>Fire resistance class of vertical linear joint seals system with lamella mat in floor: EI 120</p> <p>Fire resistance class of horizontal linear joint seals system with lamella mat in wall: EI 120</p> <p>Fire resistance class of double layer 50 linear joint seal system with lamella mat in floor: EI 120</p> <p>Fire resistance class of single layer 50 linear joint seal with mineral fiber board in floor: EI 60/E 120</p> <p>Fire resistance class of joint seals with loose mineral wool in floor: EI 120</p> <p>Fire resistance class of joint seals with filler in wall and floor: EI 120</p> <p>See Annex B for further information of fire-resistant designs.</p>
3.2 Hygiene, health and the environment (BWR3)	
Content, emission and/or release of dangerous substances ^{*)}	No performance assessed
Air permeability (material property)	No performance assessed
Water Permeability (material property)	No performance assessed
3.3 Safety in use (BWR4)	
Mechanical resistance and stability	No performance assessed
Resistance to impact/movement	No performance assessed
Adhesion	No performance assessed
Durability	Use category X

Characteristic	Assessment of characteristic
Movement Capability	No performance assessed
Cycling of perimeter seals for curtain walls	No performance assessed
Compression set	No performance assessed
Linear expansion on setting	No performance assessed

3.4 Protection against noise (BWR5)

Airborne sound insulation	No performance assessed
---------------------------	-------------------------

3.5 Energy Economy and heat retention (BWR6)

Thermal insulation	No performance assessed
Water vapour permeability	No performance assessed

*) In addition to the specific clauses relating to dangerous substances contained in this European technical Assessment, there may be other requirements applicable to the products falling within its scope (e.g., transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

See additional information in section 3.9 – 3.10.

3.9 Methods of verification

The assessment of the performance of FireFree Brandfugesystem is in relation to the applicable BWR's has been made in accordance with the European Assessment Document (EAD) no. EAD 350141-00-1106: Linear joint and gap seals.

3.10 General aspects related to the fitness for use of the product

The verification of durability is part of testing the essential characteristics. The joint sealing FireFree Brandfugesystem may be used in end-use applications according to the provisions for use category X (external use) without expecting significant changes of the characteristics relevant for fire protection. Products that meet requirements for type X, meet the requirement for all other types.

If the joint sealing according to this ETA is to be exposed to specific stresses, further tests are necessary.

The European Technical Assessment is issued for the product based on agreed data/information, deposited with ETA-Danmark, which identifies the product that has been assessed and judged. Changes to the product or production process, which could result in this deposited data/information being incorrect, should be notified to ETA-Danmark before the changes are introduced. ETA-Danmark will decide if such changes affect the ETA and consequently the validity of the CE marking based on the ETA and if so whether further assessment or alterations to the ETA, shall be necessary.

FireFree Brandfugesystem are manufactured in accordance with the provisions of this European Technical Assessment using the manufacturing processes as identified in the inspection of the plant by the notified inspection body and laid down in the technical documentation.

4 Attestation and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base


4.1 AVCP system

According to the decision 1999/454/EC of the European Commission, as amended, the system(s) of assessment and verification of constancy of performance is system **1** (see Annex V to Regulation (EU) No 305/2011).

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at ETA-Danmark prior to CE marking

Issued in Copenhagen on 2025-05-30 by

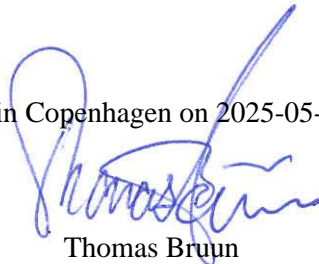

Thomas Bruun
Managing Director, ETA-Danmark

Annex A
Tabular listing of used products

Table 1.0

Designation	Manufacturer	Thickness [mm]	Gross density [Kg/m³]	Classification
FireFree Fugeforsegler solid emulsion Solid fire protection coating, ablative coating	Scandi Supply A/S Energivej 2, DK-5492 Vissenbjerg Denmark	-	1410	Class E in accordance with DIN EN 13501-1 K-3676/127/10-MPA BS
FireFree Fugefiller Filler Filling compound, ablative coating	Scandi Supply A/S Energivej 2, DK-5492 Vissenbjerg Denmark	-	1410	Class E in accordance with DIN EN 13501-1 K-3676/127/10-MPA BS
ROCKWOOL Klimarock Lamella mat/mineral fibre mats	DEUTSCHE ROCKWOOL GmbH & Co. KG D-Gladbeck	20-100	40-50	Class A1 in accordance to DIN EN 13501-1 (according to EC Certificate of Conformity No. 0751- CPD.2-0-03-01/12 DEUTSCHE Rockwool GmbH & Co. KG
ROCKWOOL ProRox LF 970 Impregnated stone wool	DEUTSCHE ROCKWOOL GmbH & Co. KG D-Gladbeck	-	-	Class A1 in accordance to DIN EN 13501-1 (according to EC Certificate of Conformity No. 0751- CPD.2-0-03-01/12 DEUTSCHE Rockwool GmbH & Co. KG
ROCKWOOL ProRox SL 790 ^P strong and rigid stone wool slab	DEUTSCHE ROCKWOOL GmbH & Co. KG D-Gladbeck	50	115	Class A1 in accordance to DIN EN 13501-1 (according to EC Certificate of Conformity No. 0751- CPD.2-0-03-01/12 DEUTSCHE Rockwool GmbH & Co. KG

Annex B

Fire resistant designs evaluated by this European Technical Assessment

Overview of the permitted applications and fire-resistant designs with regards of resistance to fire:

The joint sealing system FireFree Brandfugesystem is used for sealing linear joints in or between the:

Rigid walls: Concrete, cellular concrete or masonry

Rigid floors: Concrete or cellular concrete




Table 2.0 provides an overview of the fire-resistant designs for the installation in rigid walls and rigid floors with a thickness of 150 mm:

Application A	Application B	Application C	Application D
Fire resistance class of vertical linear joint seals system with fiber board in wall: EI 120	Fire resistance class of horizontal linear joint seals system with mineral fiber board in wall: EI 120	Fire resistance class of vertical linear joint seals system with lamella mat in floor: EI 120	Fire resistance class of horizontal linear joint seals system with lamella mat in wall: EI 120
Application E	Application F	Application G	Application H
Fire resistance class of double layer 50 linear joint seals system with mineral fiber board in floor: EI 120	Fire resistance class of single layer 50 linear joint seals system with mineral fiber board in floor: EI 60/ E 120	Fire resistance class of joint seals stuffed with loose mineral wool in floor: EI 120	Fire resistance class of joint seals with filler in wall and floor: EI 120

Annex C




Field of installation, technical drawings

Horizontal joint filling system "FireFree Brandfuge" - single layer 50 with mineral fibre board

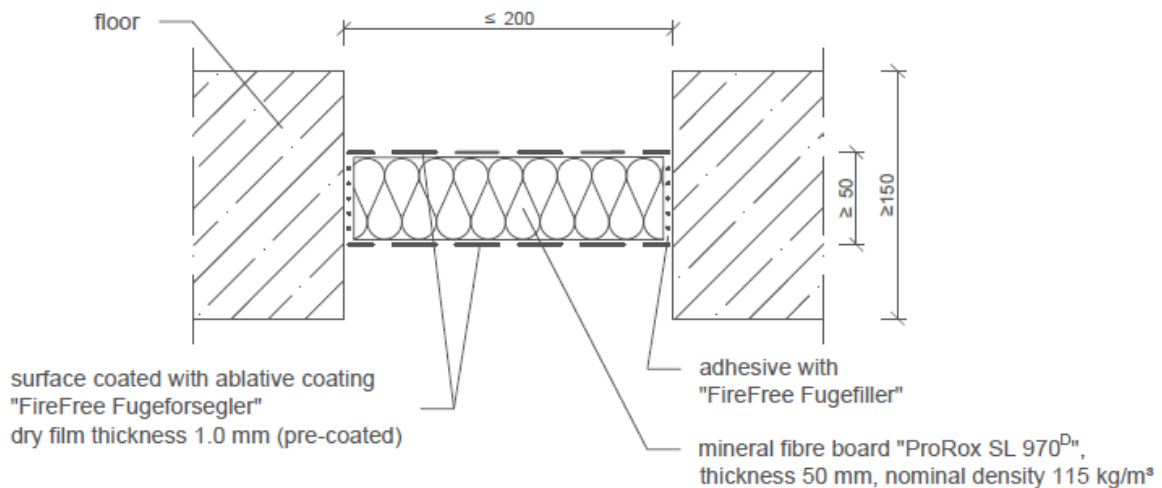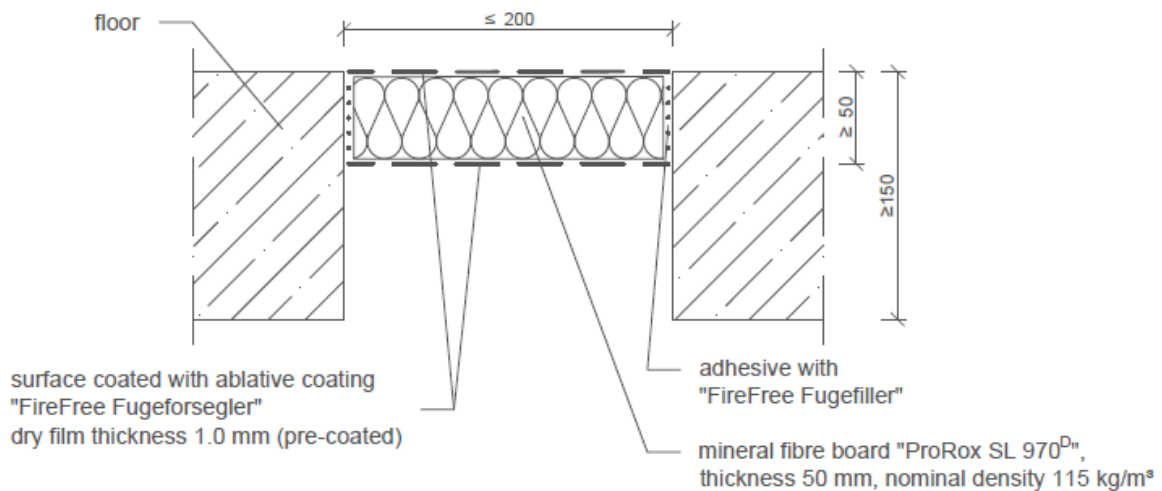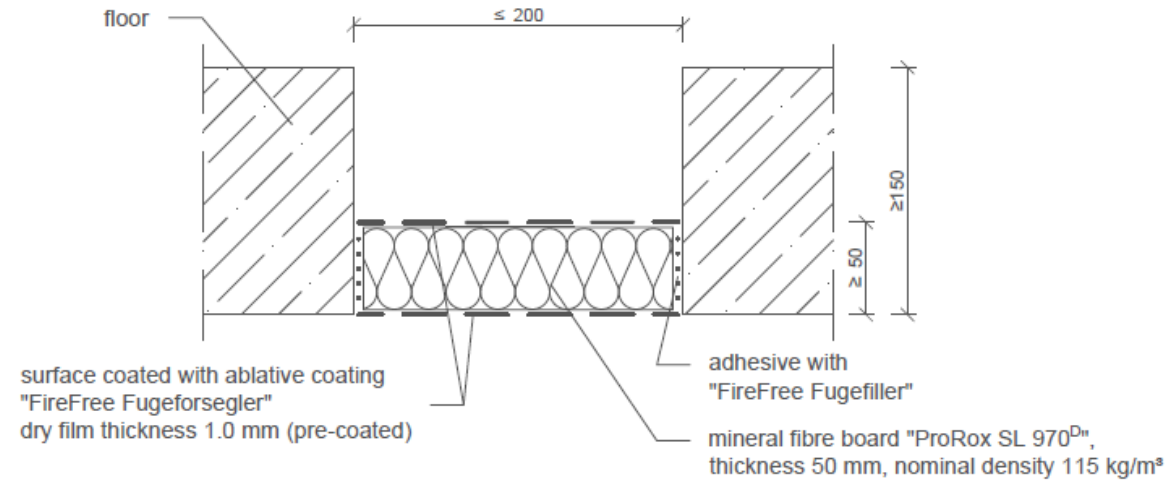


Dimensions in mm

Horizontal joint filling system "FireFree Brandfuge" - double layer 50 with mineral fibre board

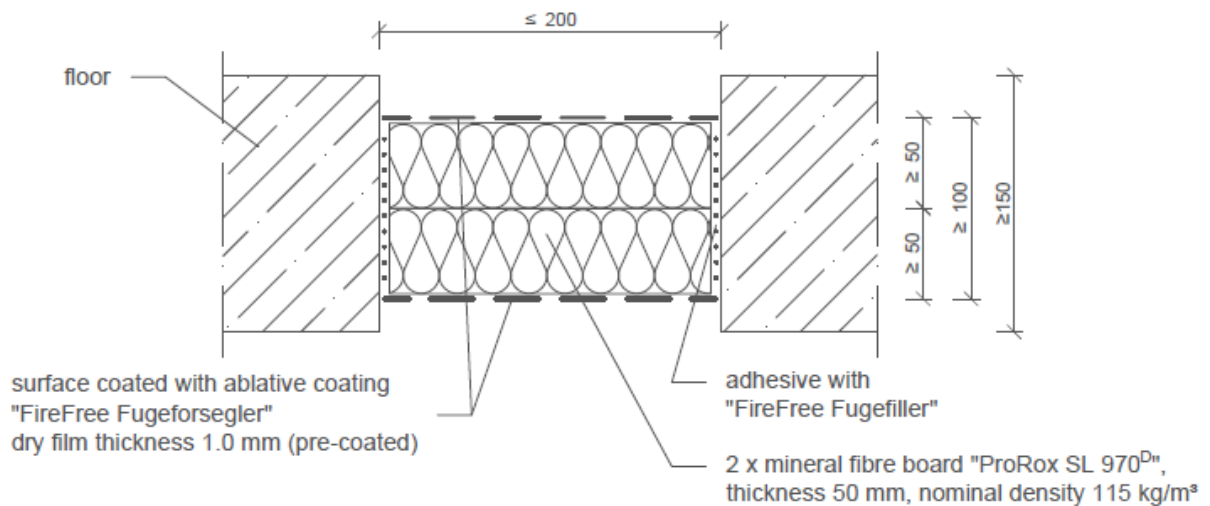
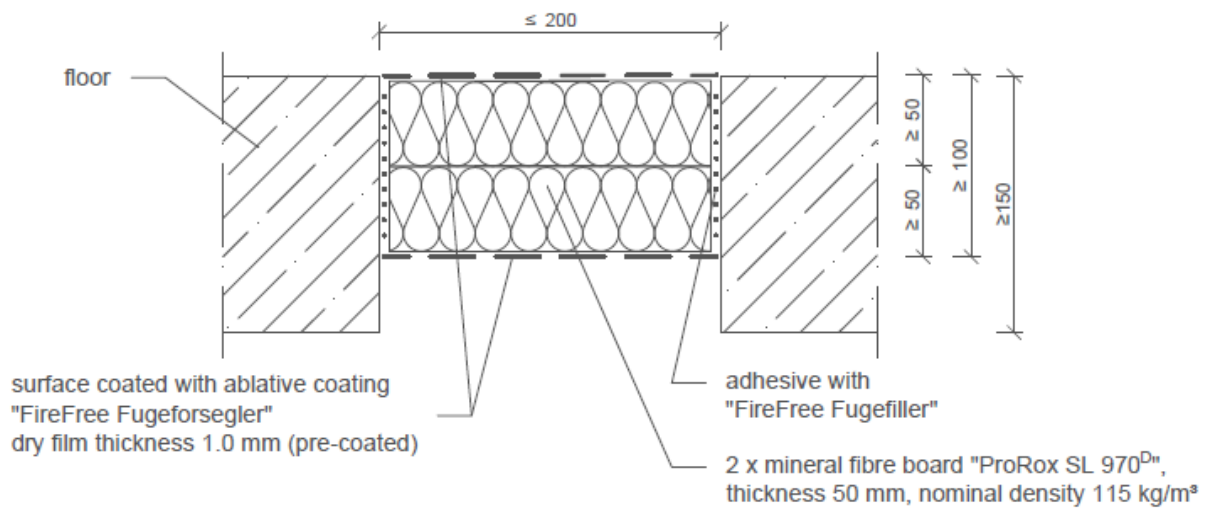
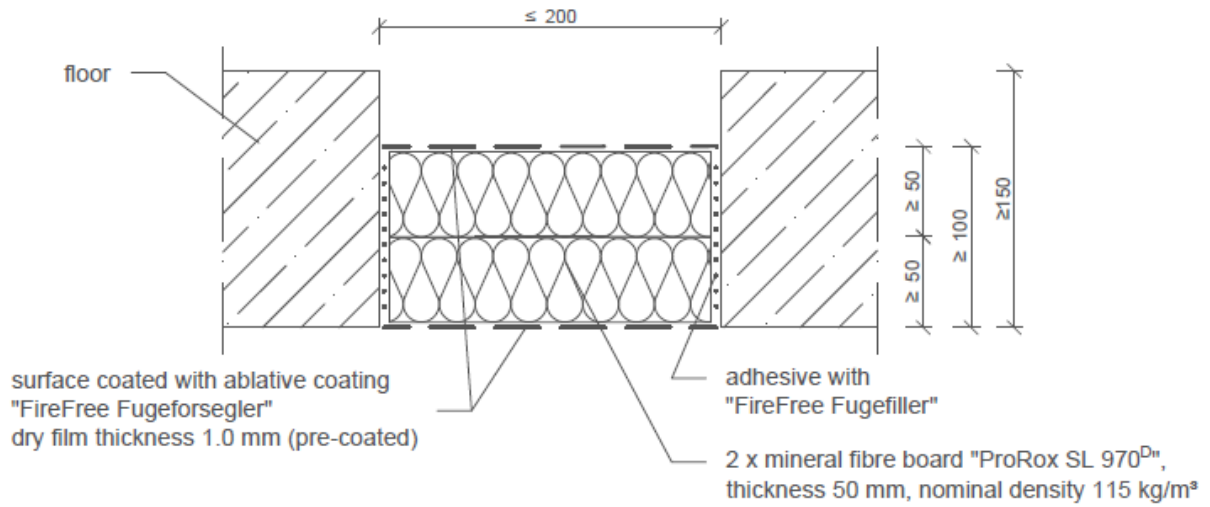


Dimensions in mm

Horizontal joint filling system "FireFree Brandfuge - stuffed with loose mineral wool"

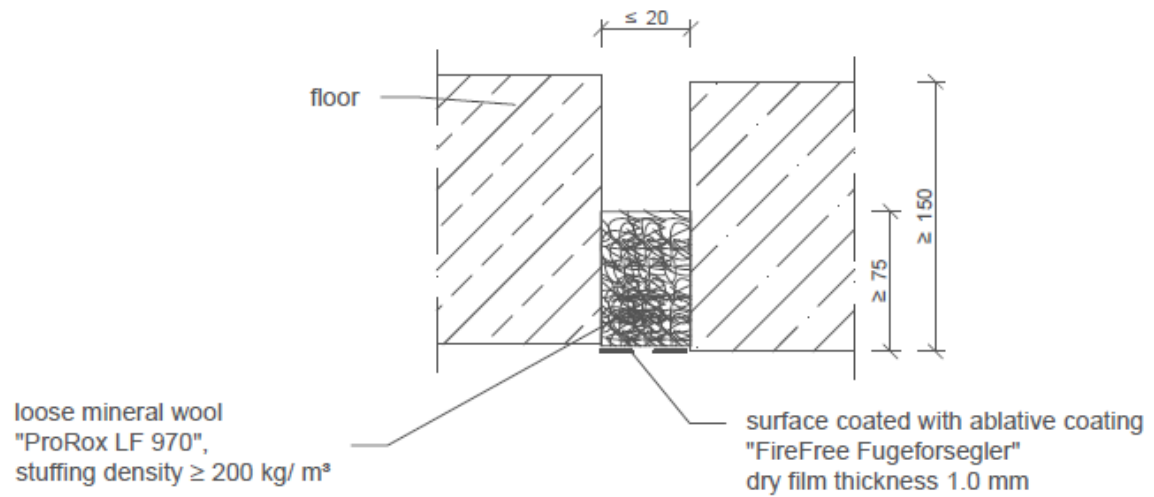


Vertical joint filling system "FireFree Brandfuge" - double layer 50 with mineral fibre board

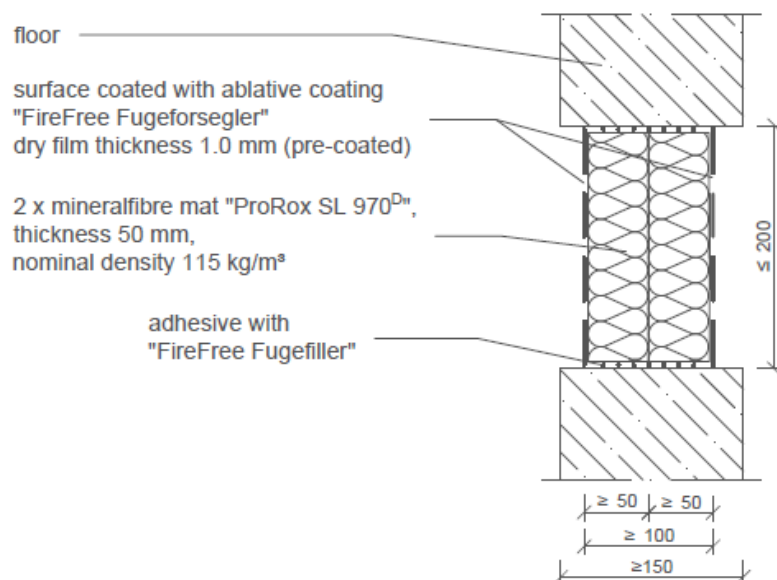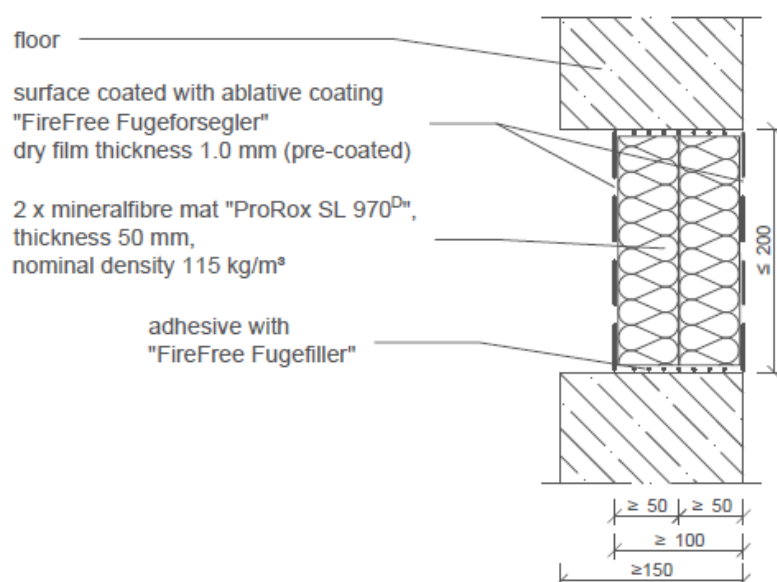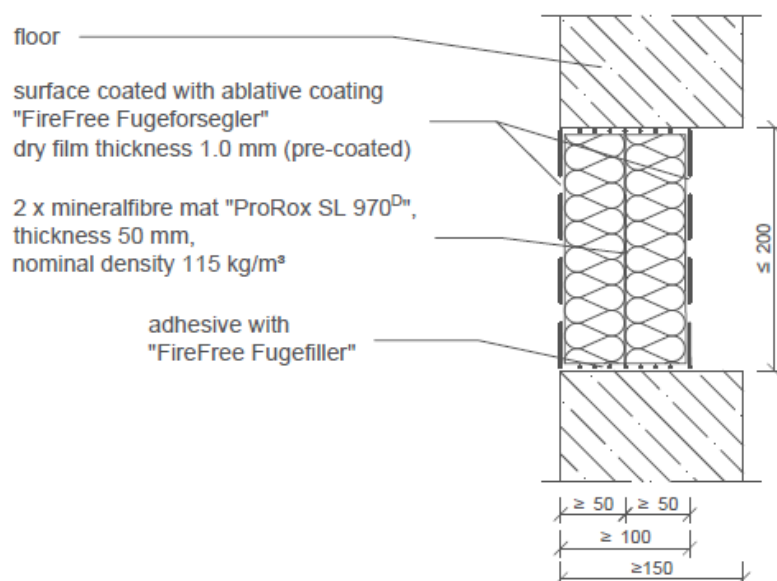


Dimensions in mm


Joint width 100 mm with lamella mat "Klimarock" and ablative coating "FireFree Fugeforsegler"

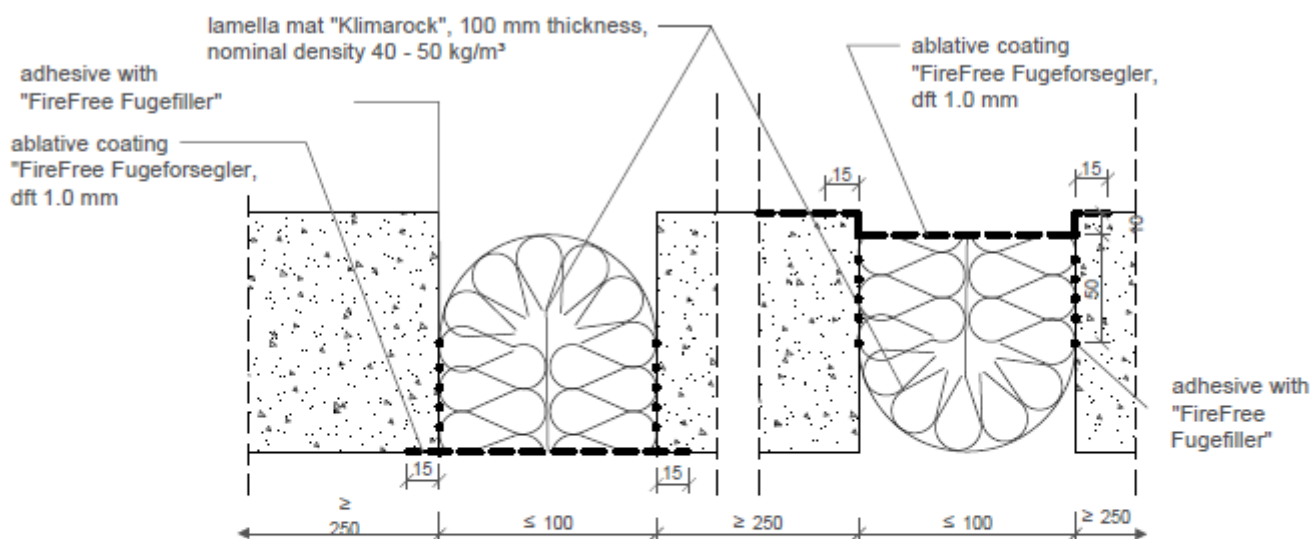

Joint width 20 mm with lamella mat "Klimarock" and ablative coating "FireFree Fugeforsegler"

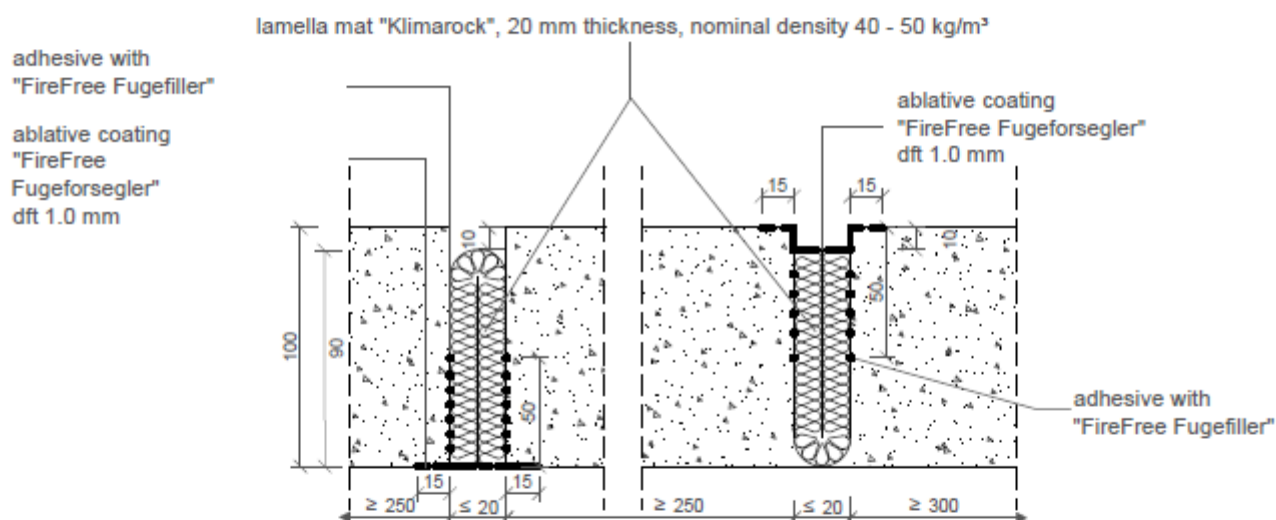

Joint width 4 mm with filler "FireFree Fugeforsegler"

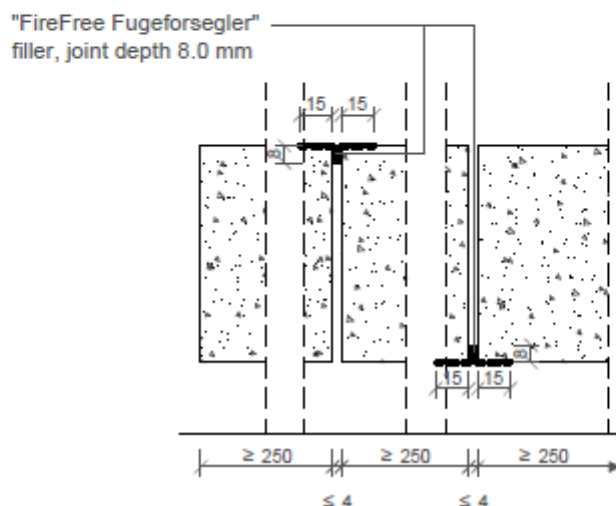

dimensions in mm

